


CONSTRUCTION SPECIFICATIONS -- SOUNDING TUBE

DOMESTIC AND IRRIGATION WELLS

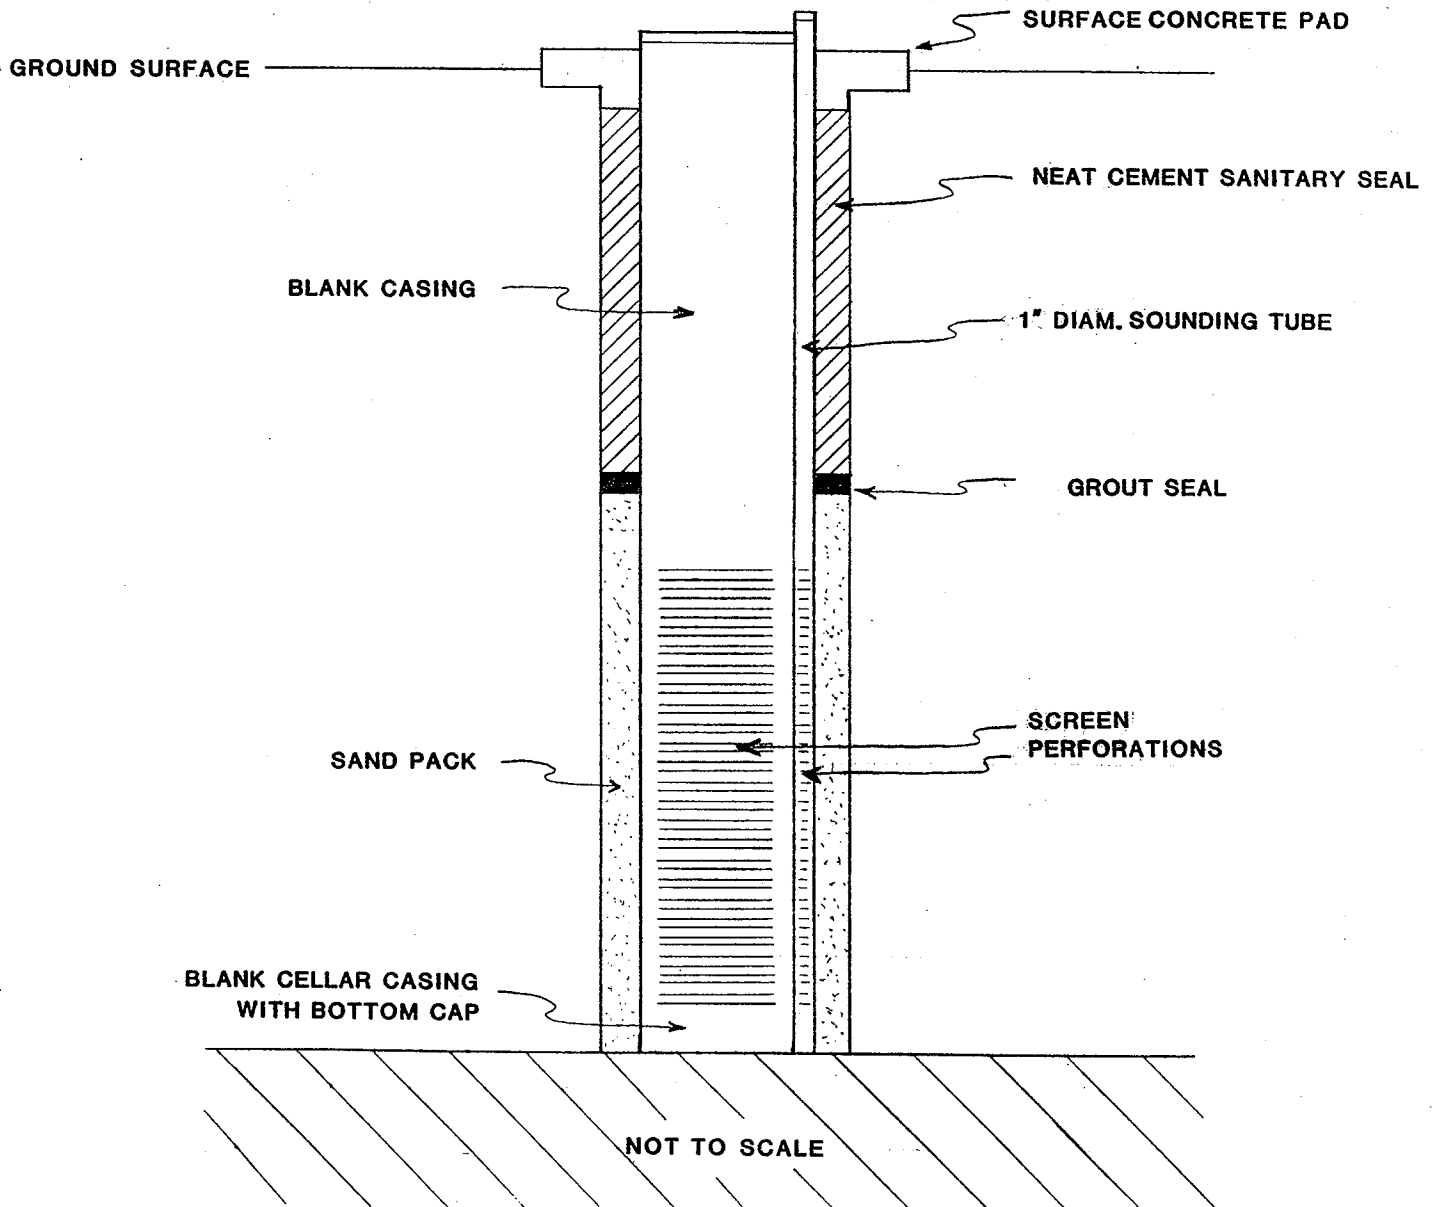

NOTE: ALL NEW WELLS WITHIN THE MONTEREY PENINSULA WATER MANAGEMENT DISTRICT MUST BE EQUIPPED WITH A SOUNDING TUBE. THE SKETCH SHOWN ABOVE ILLUSTRATES AN ACCEPTABLE METHOD FOR INSTALLING A SOUNDING TUBE. SOUNDING TUBE CAN BE STRAPPED TO OUTSIDE OF WELL CASING DURING INSTALLATION, OR MAY BE INSTALLED INSIDE WELL CASING. IN ANY EVENT, INSTALLATION SHOULD BE SUCH THAT A WATER LEVEL MONITORING DEVICE WILL NOT GET HUNG UP ON OTHER WELL PIPES, CABLES, ETC.