

Injection of ASR via separate parallel pipeline while extracting additional source water from the north, increases ASR bank and Table 13. This results in allowing Seaside Basin limits and Carmel River EDL to be met during max ASR injection year with approximately 1,000 AF buffer.

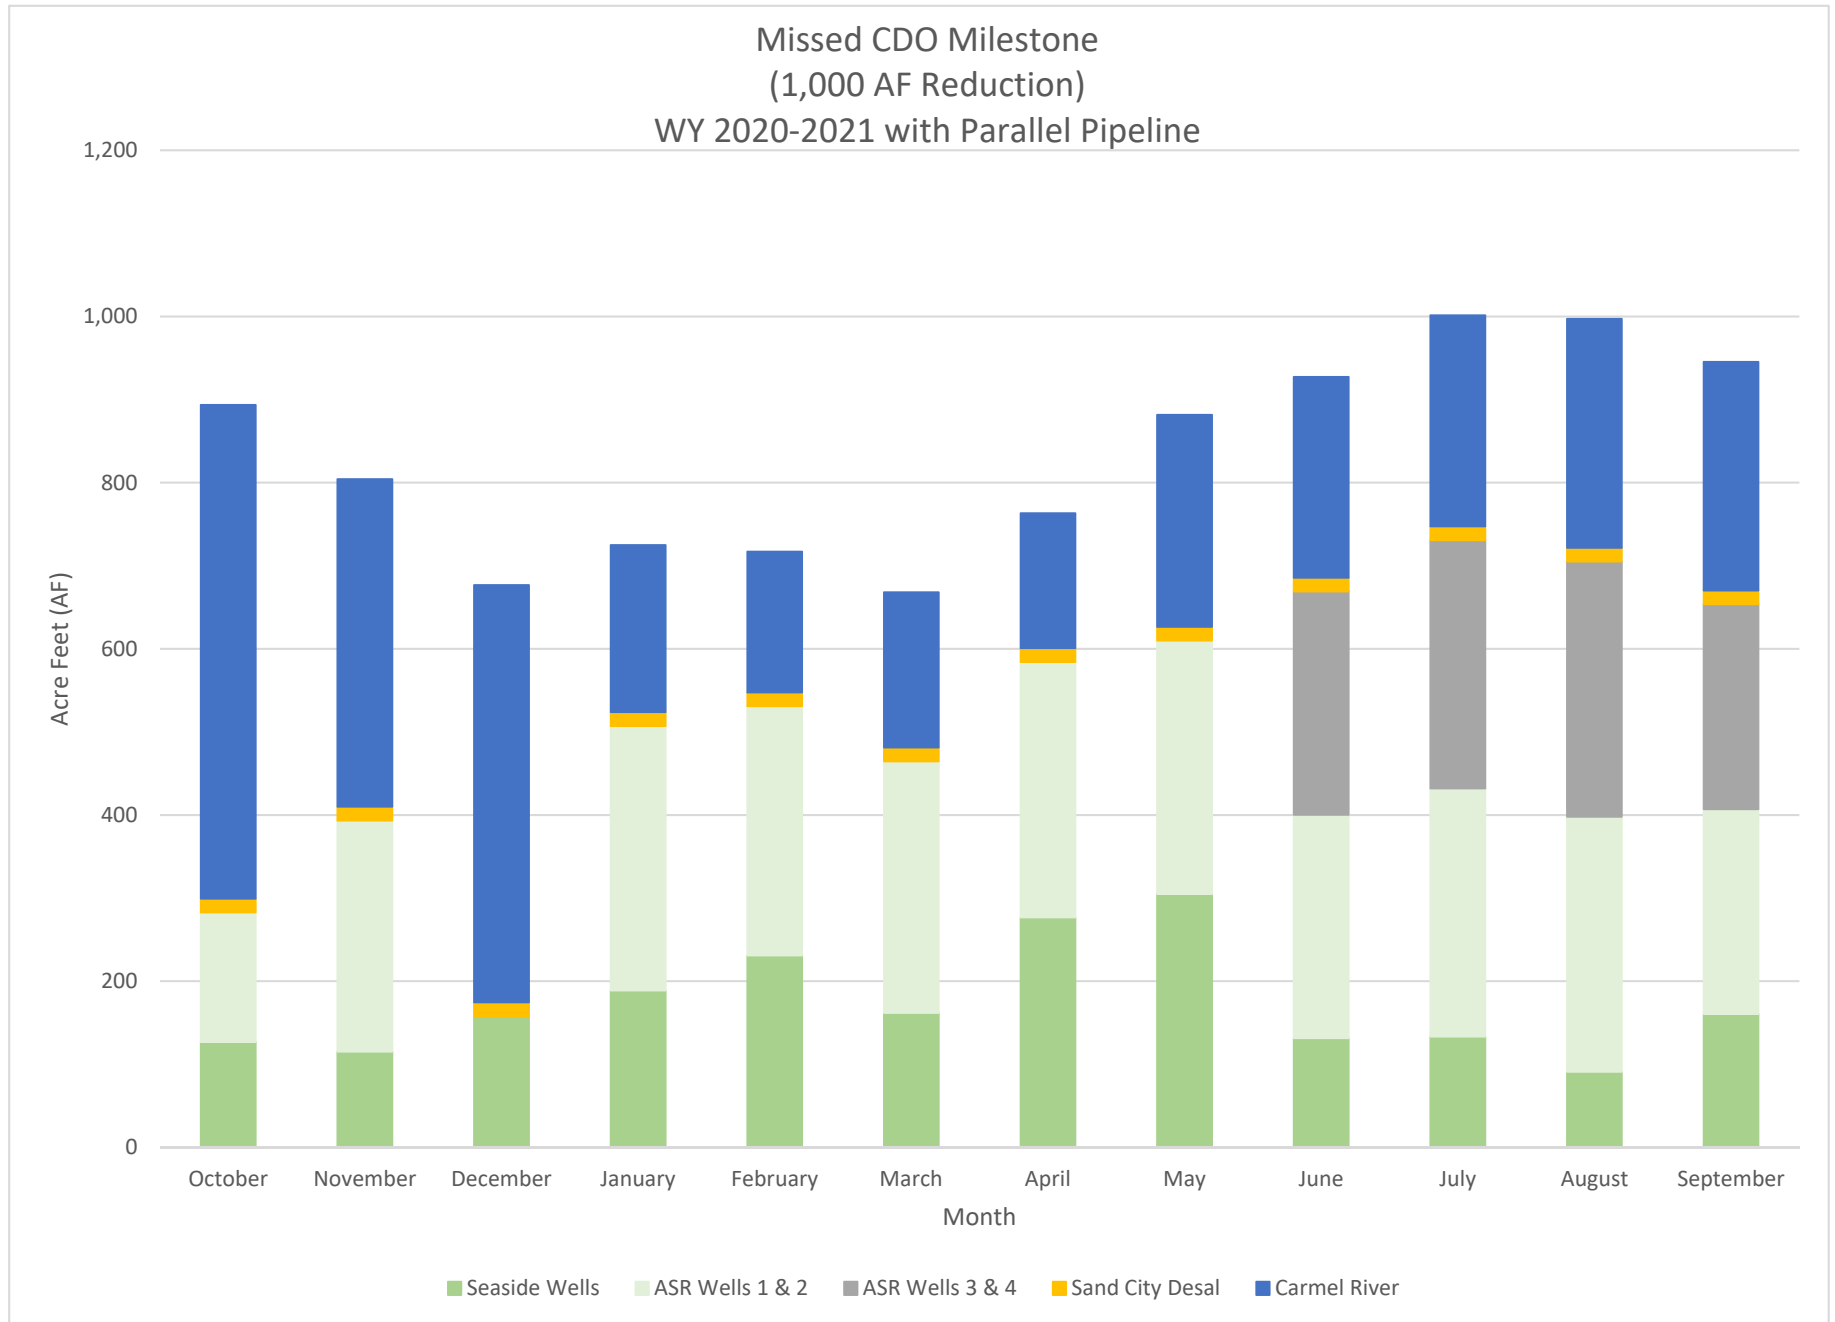


EXHIBIT 3-B